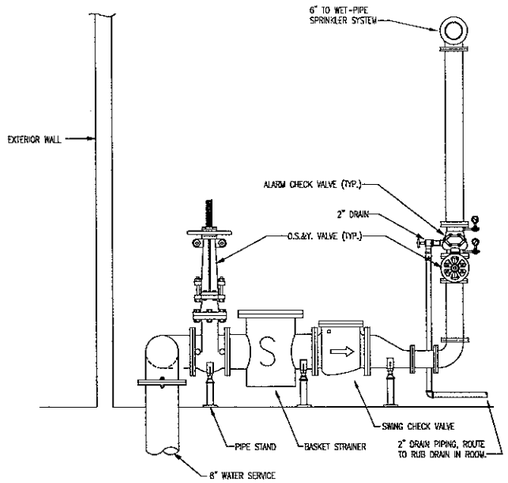

WET-PIPE SPRINKLER RISER
N.T.S.

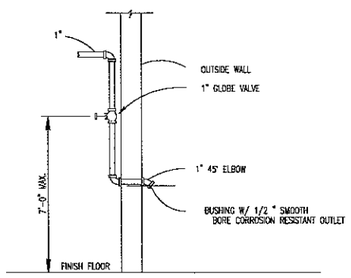

INSPECTORS TEST CONNECTION
FOR WET PIPE SPRINKLER SYSTEM
N.T.S.

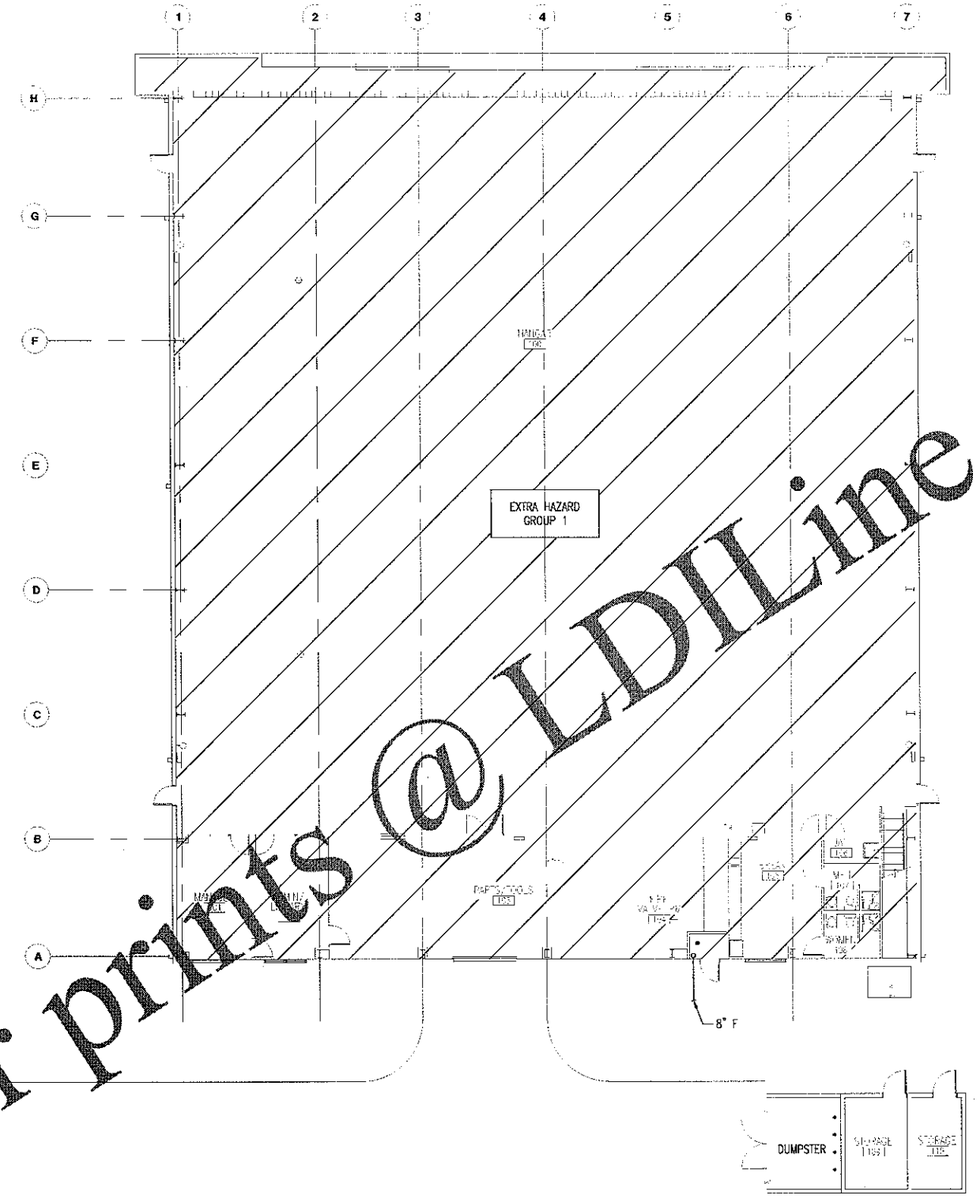

1 / F1 FIRE PROTECTION HANGAR FLOOR PLAN
SCALE: 3/32" = 1'-0"

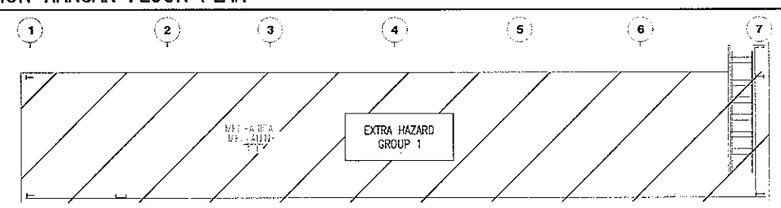

2 / F1 FIRE PROTECTION HANGAR MEZZANINE PLAN
SCALE: 3/32" = 1'-0"

SCALE: 3/32" = 1'-0"

Order prints @ LDILine.com

COPYRIGHT © 2001 STOTTLER STAGG & ASSOCIATES

STOTTLER STAGG + ASSOCIATES
ARCHITECTS ENGINEERS PLANNERS INC
8402 N. Atlantic Avenue, Cape Canaveral, FL 32920
Phone (321) 799-1020
FAX (321) 799-7965
www.stottlerstagg.com

Consultant

Revisions/Comments

Cadd File Information
Cadd File:
Scale:
XRef: SSA-BORDER.DWG
XRef:
XRef:
XRef:
Font: RDMANS
Font: AU2
Font:

Drawing Information
Drawn by: JPY
Checked by: DKP
Approved by: DKP
Date: 9-4-07

SSA Job Number
07-0022

Project Name and Location
THE EMIL BUEHLER AVIATION TRAINING BUILDING, AIRCRAFT HANGAR, AND ASSOCIATED SITE IMPROVEMENTS

Sheet Title
FIRE PROTECTION HANGAR PLAN

DAVID K POETKER
FLORIDA PE 62073
Seal

Drawing Number
F-01

Drawing Of