


FIELD VERIFY EXACT LOCATION OF EXISTING 4\"/>

FIELD VERIFY EXACT LOCATION OF EXISTING 4\"/>

REMOVE TOP SINK, CUT AND PLUG WASTE AT FLOOR, CUT AND CAP WATER PIPING AT WALL

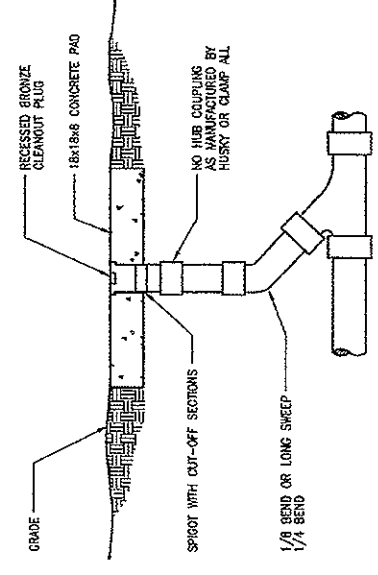

2 GRADE CLEANOUT DETAIL
P.11 SCALE: NONE

1 PARTIAL THIRD FLOOR PLUMBING PLAN
P.11 SCALE: 1/4" = 1'-0"

NODUS LLC
448 11th Street NW
Atlanta Georgia 30319
Tel: 404.592.2110
Fax: 404.592.2110
www.nodusllc.com


Spencer Bristol Engineering, Inc.
1000 Peachtree Street, NE
Atlanta, Georgia 30309
Tel: 770.251.6588 Fax: 770.466.0281
SSE Project No. 0009

Bioscience 404 E Auditorium Renovation
University of Georgia
Athens, GA - 30602
Physical Plant Division
University of Georgia


MARK	DATE	DESCRIPTION
03/19/07	BID DOCUMENTS	
04/05/07	PFD REVIEW SET	

PROJECT NO. 0009
DRAWN BY: []
CHECKED BY: []
DATE: []
COPRIGHT © 2007 NODUS LLC
SHEET TITLE: PARTIAL THIRD FLOOR PLUMBING PLAN

P-1.1

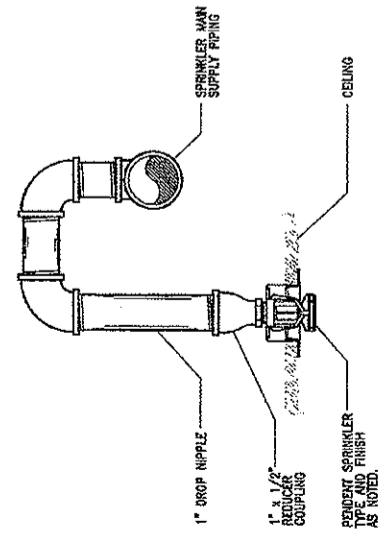

3 RETURN BEND DETAIL
SCALE: NONE

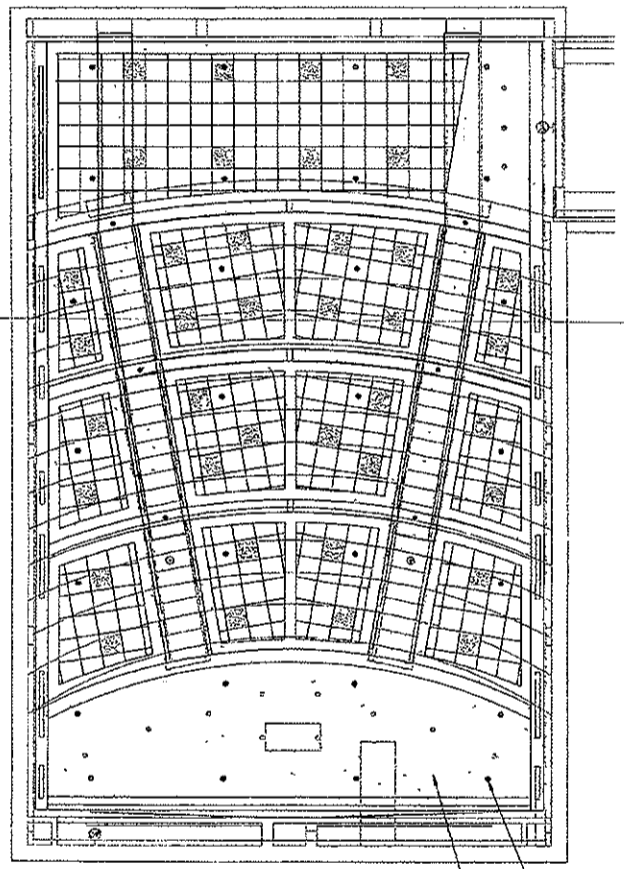

1 AUDITORIUM FIRE PROTECTION PLAN
SCALE: 1/8" = 1'-0"

FIRE PROTECTION NOTES

PROVIDE MODIFICATIONS TO THE EXISTING SPRINKLER SYSTEM AS SPECIFIED AND INDICATED ON THIS DRAWING. SYSTEM SHALL BE DESIGNED FOR LIGHT HAZARD OCCUPANCY EXCEPT WHERE THE CODE REQUIRES OTHERWISE.

SPRINKLER HEADS IN DRYWALL CEILINGS SHALL BE WIRING IMAGE CONCEALED PENDENT SPRINKLERS. COVER PLATE SHALL BE RUBY COLORED.


SPRINKLER HEADS IN ACoustICAL TILE CEILINGS SHALL BE WIRING IMAGE CONCEALED PENDENT SPRINKLERS. COVER PLATE SHALL BE WHITE COLORED.

SPRINKLER HEADS IN ACoustICAL TILE CEILINGS SHALL BE LOCATED IN THE CENTER OF THE TILE.

SPRINKLER HEADS IN DRYWALL CEILINGS SHALL BE ALIGNED WITH EACH OTHER AND WITH THOSE IN ACoustICAL TILE CEILINGS WHERE POSSIBLE.

SPRINKLER LOCATIONS INDICATED ON THE PLANS ARE FOR INTENT ONLY. THE SPRINKLER CONTRACTOR IS RESPONSIBLE FOR PROVIDING A COMPLETE FUNCTIONAL SYSTEM IN ACCORDANCE WITH THE SPECIFICATIONS, AND CODES AND STANDARDS LISTED THEREIN. WHERE POSSIBLE, RE-USE THE EXISTING SPRINKLER PIPING.

THE MODIFIED SPRINKLER SYSTEM SHALL BE TESTED AND CERTIFIED.

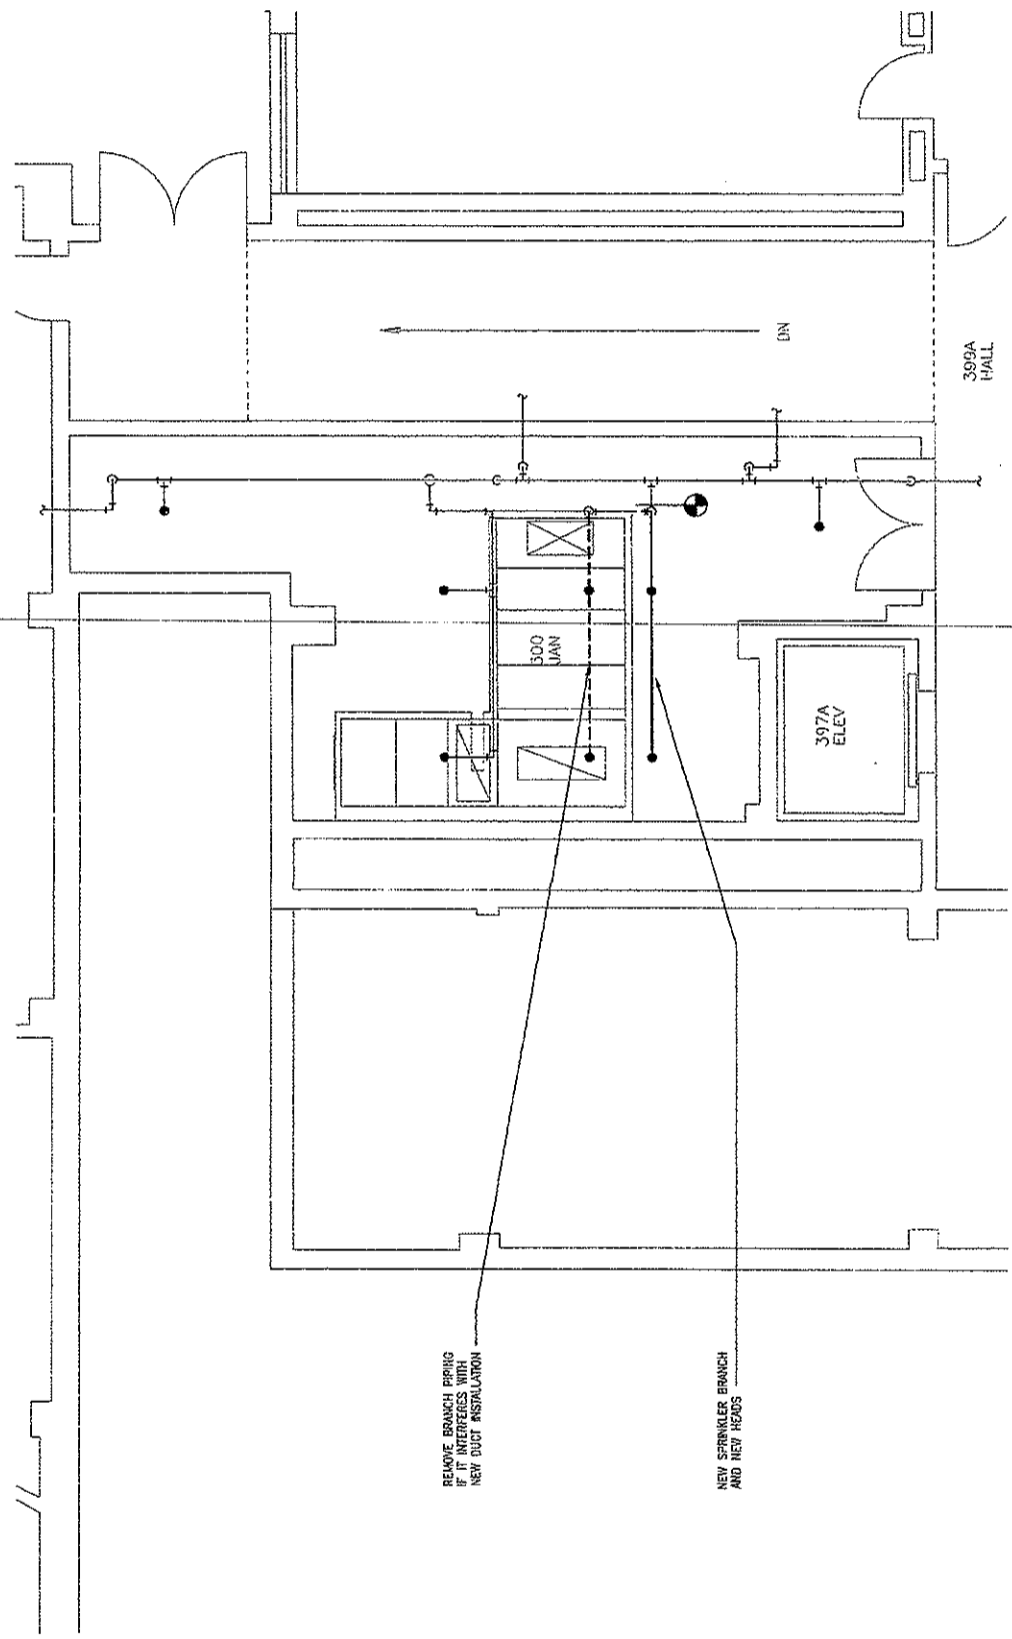

2 MECHANICAL ROOM FIRE PROTECTION PLAN
SCALE: 1/4" = 1'-0"



NODUS LLC
4411th Street NW
Atlanta Georgia 30318
Tel: 404.593.2110
Fax: 404.593.2110
www.nodusllc.com

CONSULTANTS



Spencer Bristol Engineering, Inc.
4400 The Oaks Parkway, Suite 210
Newport, Oregon 97156
Tel: 770.14.1823 Fax: 770.141.0021
SBE Paper No. 0009



Bioscience 404 E Auditorium Renovation
Athens, GA - 30602
University of Georgia
Physical Plant Division

MARK	DATE	DESCRIPTION
03/19/07		BID DOCUMENTS
03/08/07		FFO REVIEW SET

PROJECT NO: 0400
 MODEL FILE: 0400SPT1
 DRAWING: 0400
 OWNER: UG
 CONTRACTOR: 0207NODUS LLC

**AUDITORIUM AND MECHANICAL ROOM
FIRE PROTECTION DRAWINGS**

FP-1.1